




ARV & BOX PLACEMENT

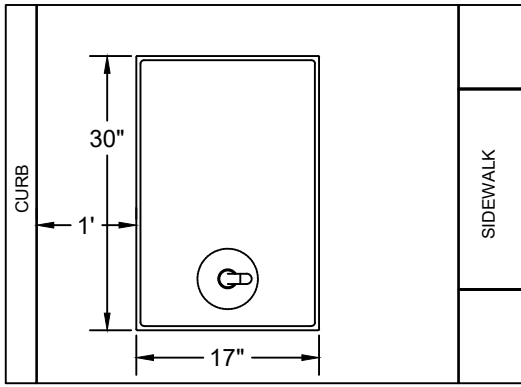

Ground Level

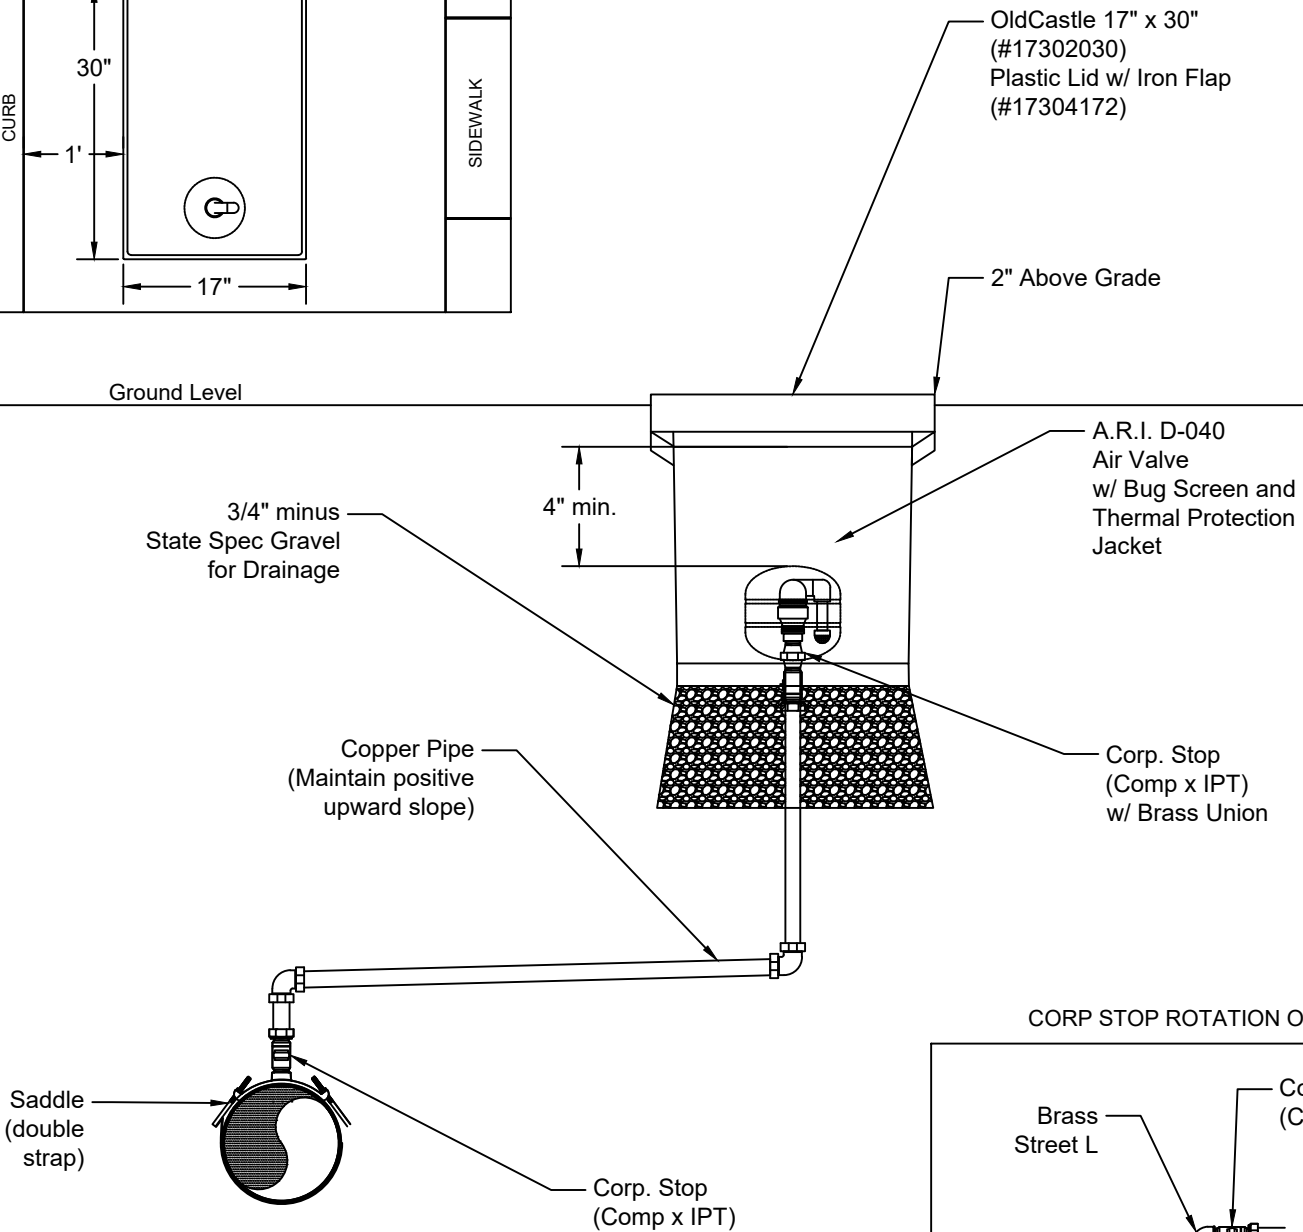

CORP STOP ROTATION OPTION

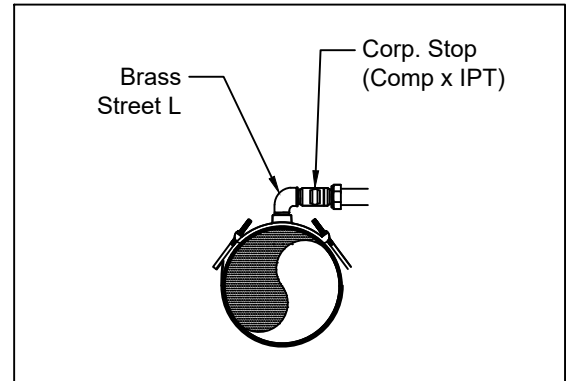

BOX NOT TO BE SET IN HARD SURFACES

MAINLINE PIPE SIZE	AIR RELIEF (Size Required)	CORP STOP (Size Required)	SADDLE (Size Required)
4" - 12"	1"	1"	(4" - 12") x 1"
14" - 24"	2"	2"	(14" - 24") x 2"

DWN BY: TEL
 DATE: JAN 2022

Avion design specifications do not relieve the developer, engineer, or contractor from responsibility to design and construct the water system in accordance with good engineering and construction practices. Must adhere to OAR 333-061-0050 Construction Standards.

AVION WATER CO
 60813 PARRELL RD BEND, OR 97702

AIR RELIEF
 METER BOX APPLICATIONS

NOT TO SCALE

REV/DATE	
REV/DATE	
REV/DATE	