


AVION WATER CO FIRE LINE

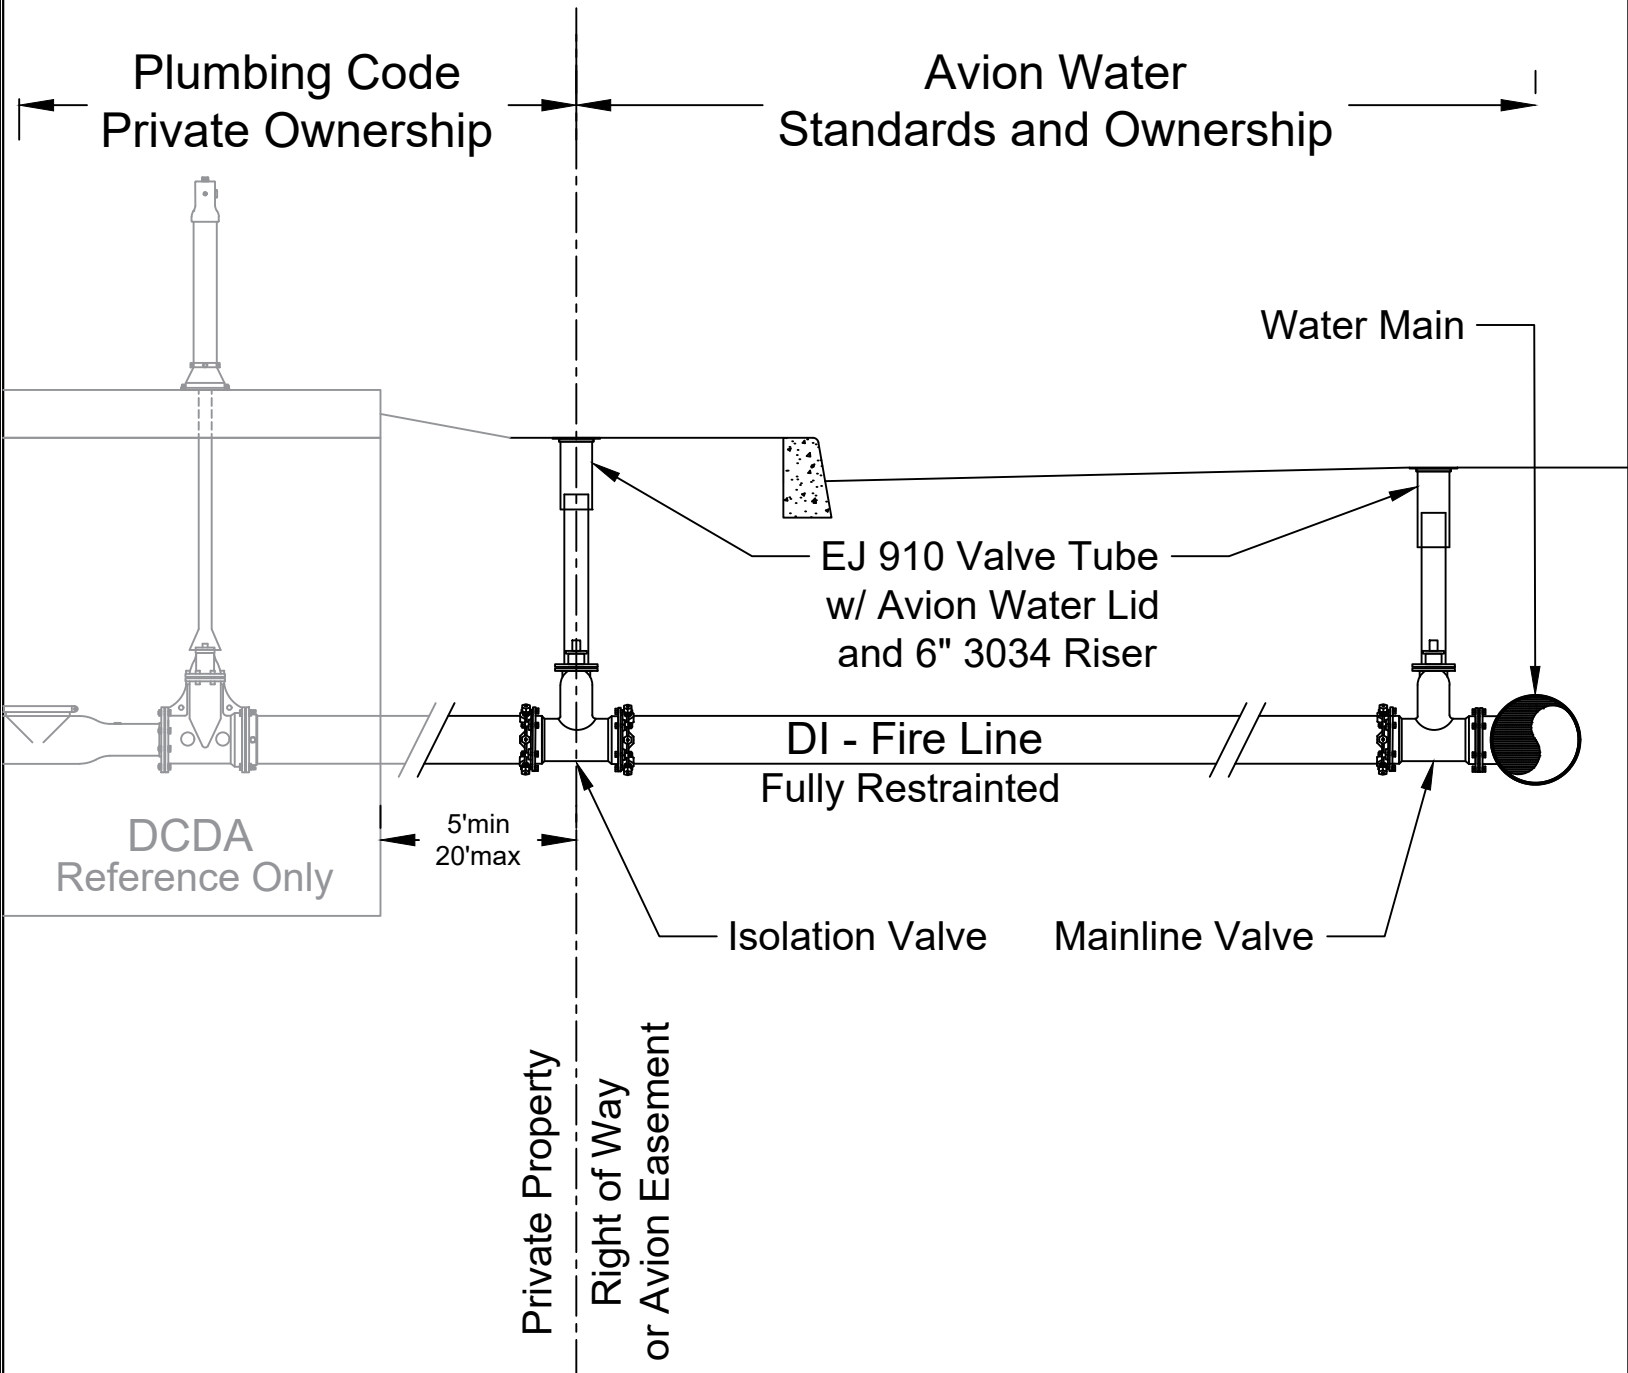

NOTES:

1. The Fire Line within the Right of Way or Avion Easement shall be constructed with Fully Restrained Ductile Iron pipe, and meet all other Avion Water construction standards.
2. The fire vault and all plumbing beyond the isolation valve shall be installed according to Plumbing Code and inspected by the applicable City or County Building Department. The fire vault and DCDA are shown for reference only. The fire vault shall be located between 5ft and 20ft from the Isolation Valve, and fully restrained ductile iron pipe.
3. The Fire Line shall be sized by the Engineer of Record.

DWN BY: TEL

DATE: Jan 2024

Avion design specifications do not relieve the developer, engineer, or contractor from responsibility to design and construct the water system in accordance with good engineering and construction practices. Must adhere to OAR 333-061-0050 Construction Standards.

AVION WATER CO
60813 PARRELL RD BEND, OR 97702

FIRE LINE

NOT TO SCALE	
REV/DATE	
REV/DATE	
REV/DATE	