
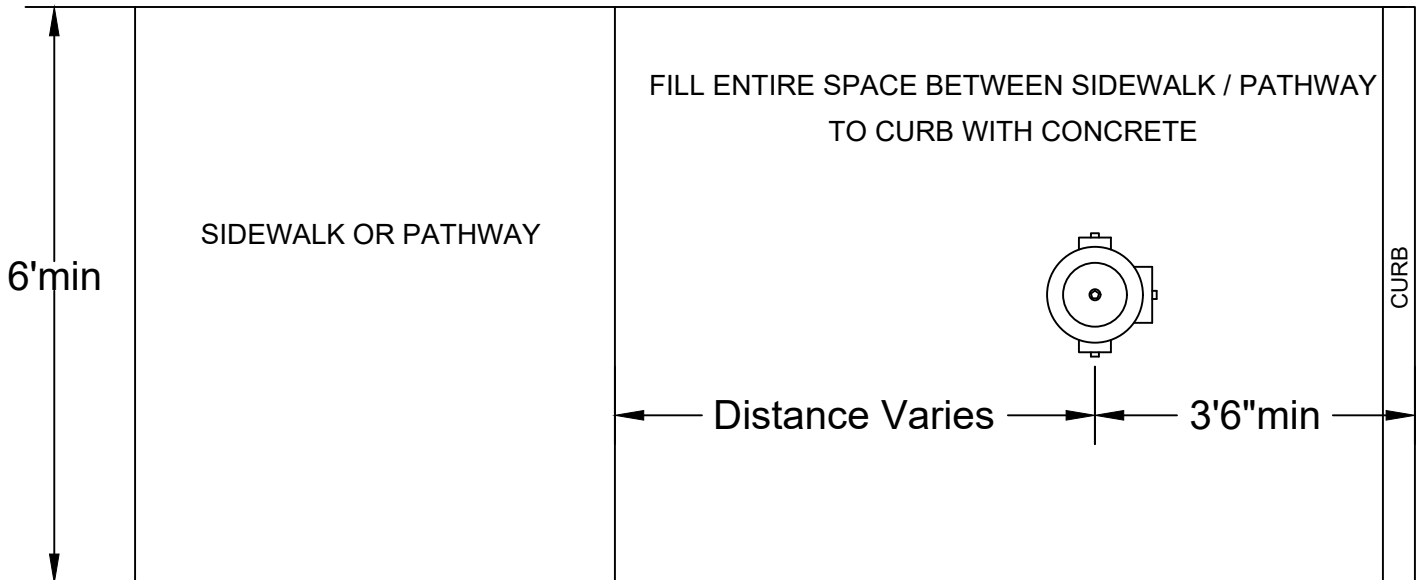


AVION WATER CO Hydrant Pad

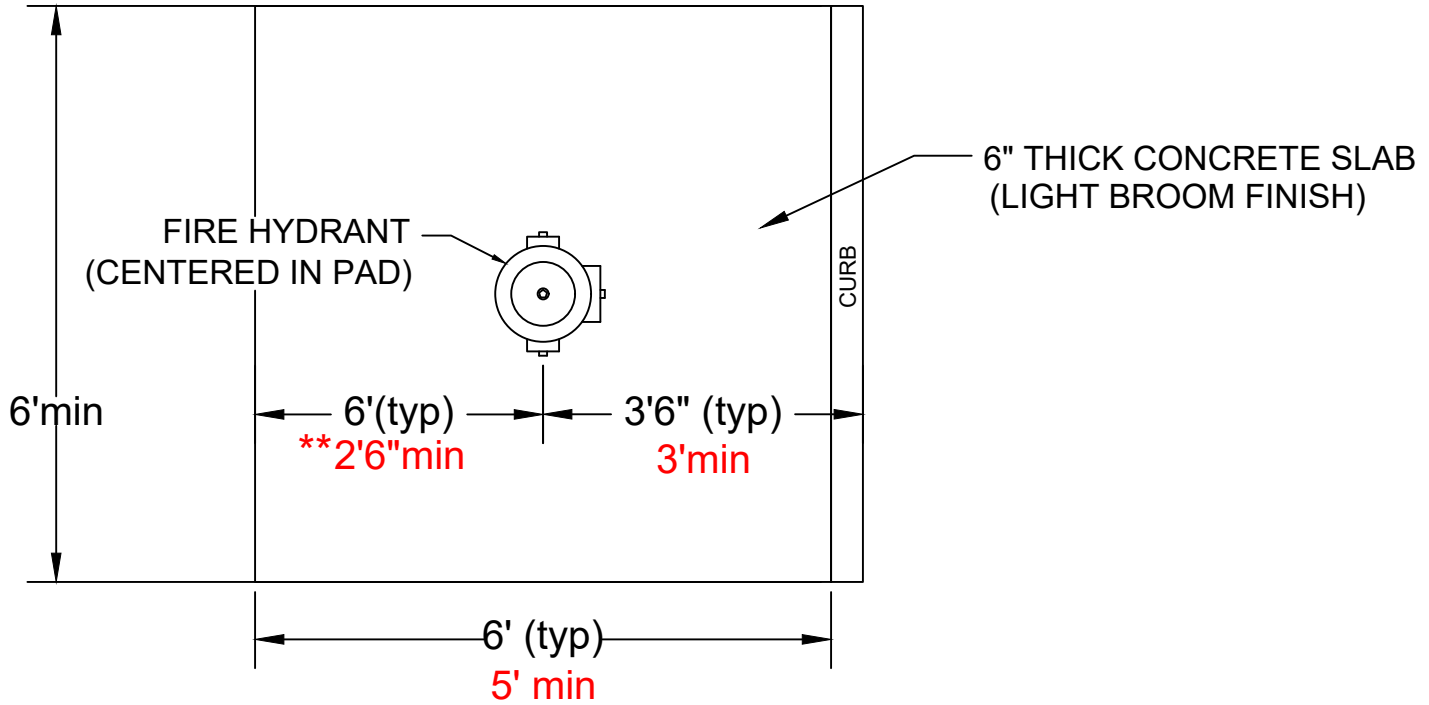

1. WHERE SIDEWALK OR PATHWAY IS FURTHER THAN 6FT FROM THE CURB CONCRETE SHALL BE POURED FROM THE CURB TO SIDEWALK OR PATH AND MAINTAIN SPECIFIED DISTANCE FROM CURB.
- **** 2. ALL HYDRANTS MUST MAINTAIN 2.5FT MIN. CLEARANCE (MEASURE FROM CENTER OF HYDRANT) FROM ALL SIDEWALKS, PATHWAYS, RETAINING WALLS OR CURBS.
3. ALL PIPE AND HYDRANT PAD SHALL BE AND BACKFILLED WITH COMPACTED 3/4"-0, OR EQUIVALENT
- 4. HYDRANTS SHALL NOT BE SET WITHIN AN AREA SMALLER THAN 5FT FROM CURB TO SIDEWALK OR WALKWAY.**

DWN BY: TEL	Avion design specifications do not relieve the developer, engineer, or contractor from responsibility to design and construct the water system in accordance with good engineering and construction practices. Must adhere to OAR 333-061-0050 Construction Standards.	<h2 style="margin: 0;">AVION WATER CO</h2> <p style="margin: 0;">60813 PARRELL RD BEND, OR 97702</p> <h1 style="margin: 10px 0 0 0;">HYDRANT PAD</h1>	NOT TO SCALE
DATE: MAY 2024			REV/DATE
<p style="margin: 0; font-size: 8px;">Avion Water BEND, OREGON</p>			REV/DATE
			REV/DATE