


AVION WATER CO FIRE LINE

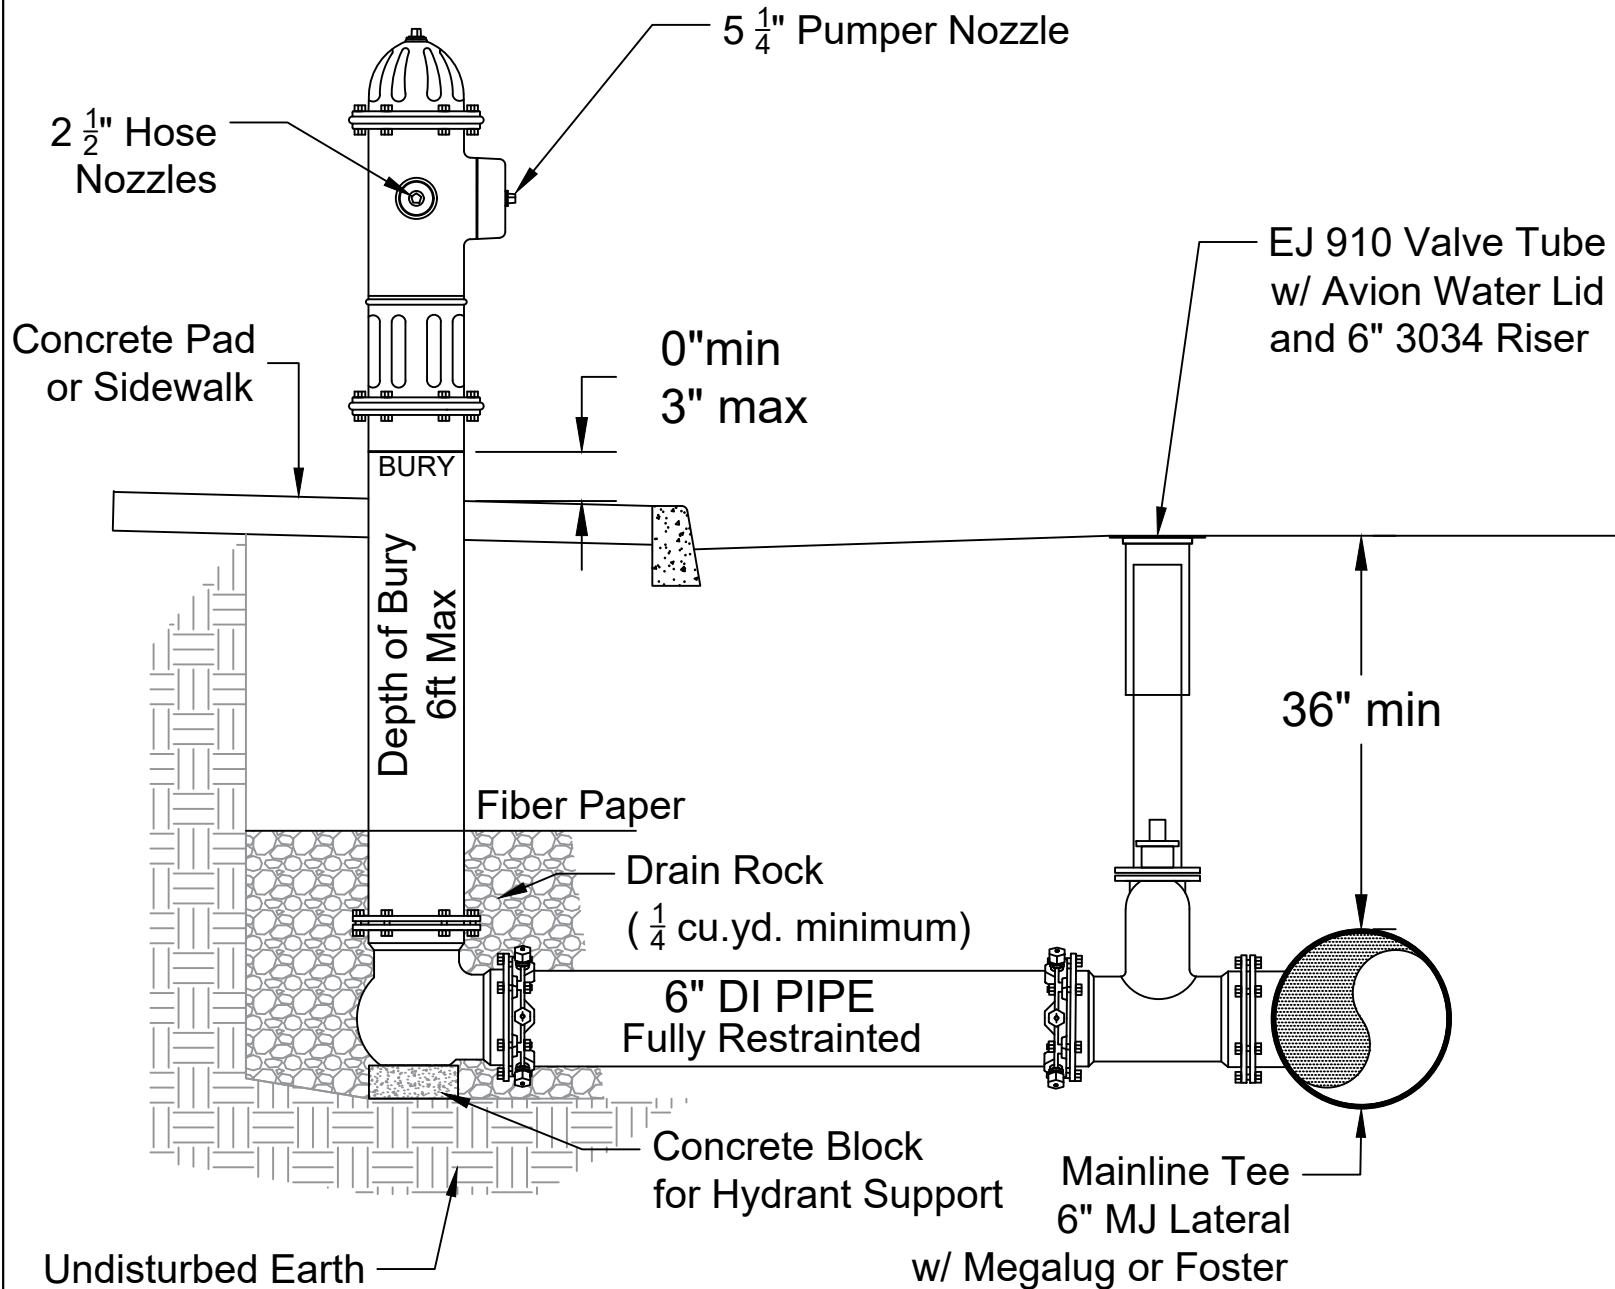

NOTES:

1. Hydrant lines shall be 6" and be a maximum of 400ft in length. Avion may require 8" for hydrant lines longer than 400ft.
2. MJ x MJ Tee with Gate Valve at the mainline, restrained with megalug or Foster adapter.
3. Set Hydrant plumb and compact all backfill per specification.
4. Finish grade of Hydrant shall be set at bury line, to a maximum of 3" below bury line.
5. All pipe for fire hydrants shall be ductile iron pipe, and fully restrained.
6. Any special circumstances, please refer to the Design Manual at avionwater.com/Construction Specifications.

DWN BY: TEL
DATE: Jan 2022

Avion design specifications do not relieve the developer, engineer, or contractor from responsibility to design and construct the water system in accordance with good engineering and construction practices. Must adhere to OAR 333-061-0050 Construction Standards.

AVION WATER CO
60813 PARRELL RD BEND, OR 97702

FIRE HYDRANT

NOT TO SCALE	
REV/DATE	
REV/DATE	
REV/DATE	