AVION WATER CO

HYDRANT & SAMPLE STATION
COMBINATION PAD DETAILS

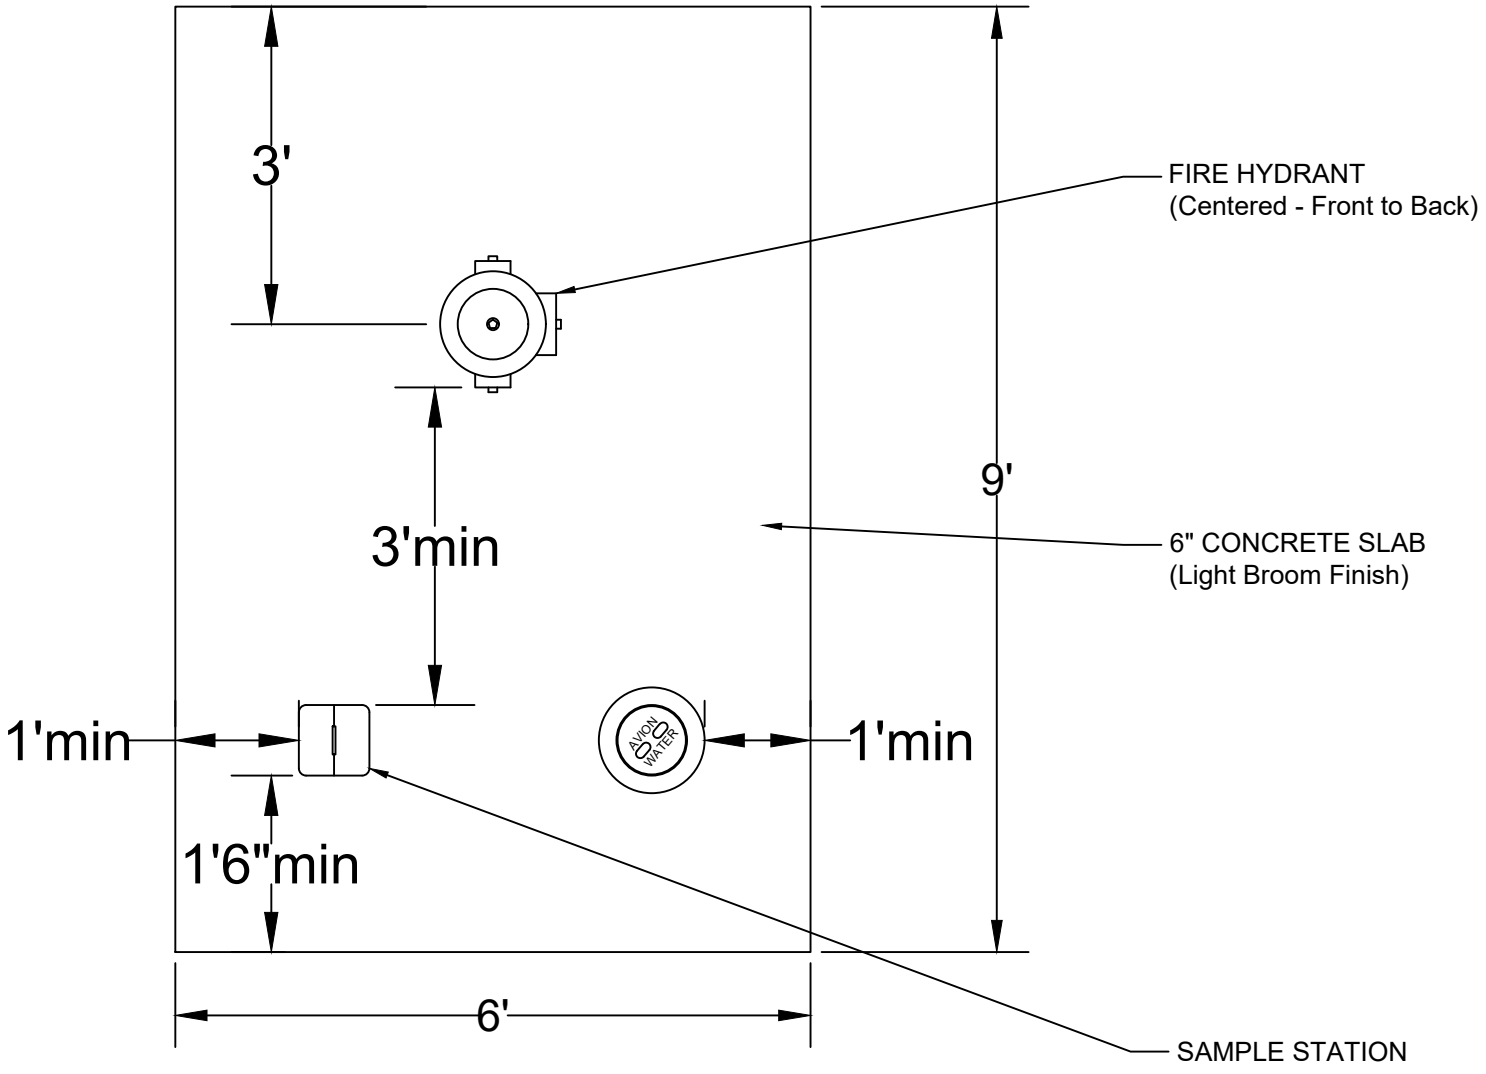

ALL PIPE AND HYDRANT PAD SHALL BE
BACKFILLED WITH COMPACTED 3/4"-0, OR EQUIVALENT

Rev. A, Jan. 2020