


**FOR NEW CONSTRUCTION
METER & DCVA INSTALLATION**

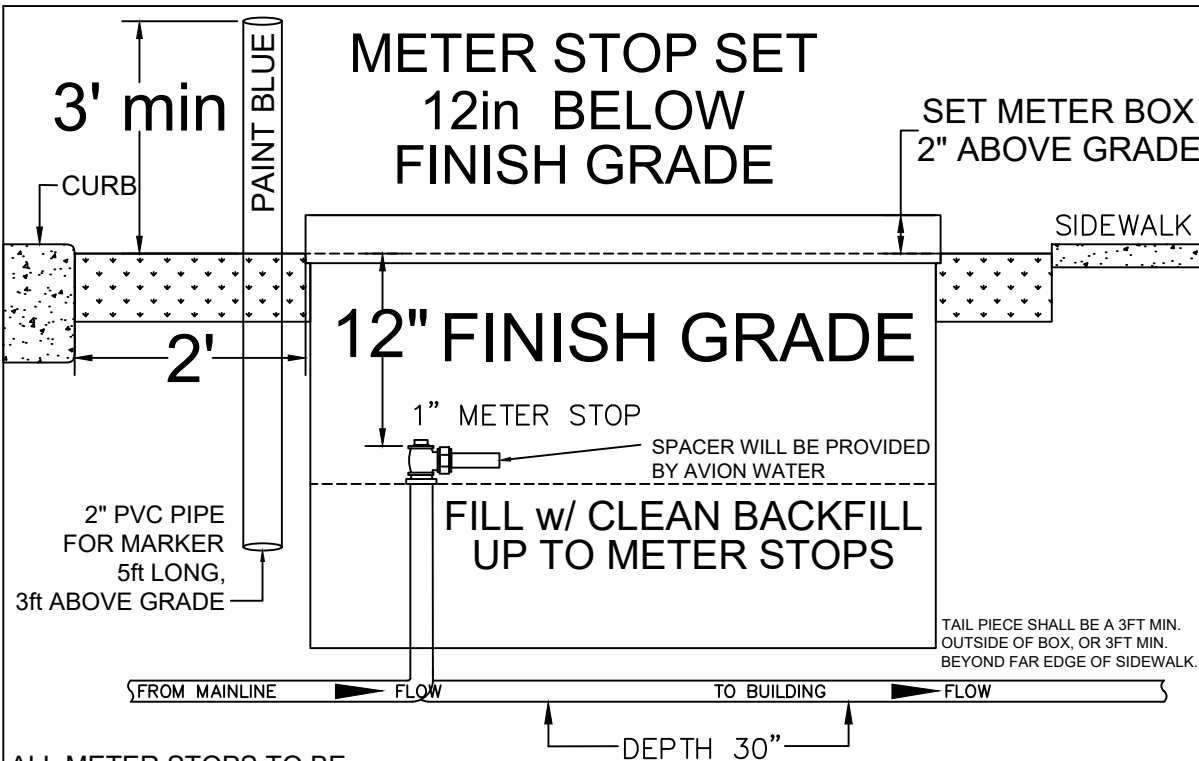

ALL METER STOPS TO BE:

1" MUELLER OR EQUIVLENT

SEE POLICY FOR SERVICES IN SUBDIVISIONS

FOR METER/BPA BOX AND LID SPECIFICATIONS

**COMPACTION REQUIRED
6" Clearance Between Boxes**

