

Flint Ln. Affected Area

11-14-23

Due to an emergency system repair in the Flint Ln. area, a precautionary boil water notice has been issued. If you are receiving this message the advisory is applicable to you. You will be contacted again when this advisory is lifted. If you have further questions, please call our office at 541-382-5342 or visit our website at avionwater.com.

ADDRESS

60935 GRANITE DR

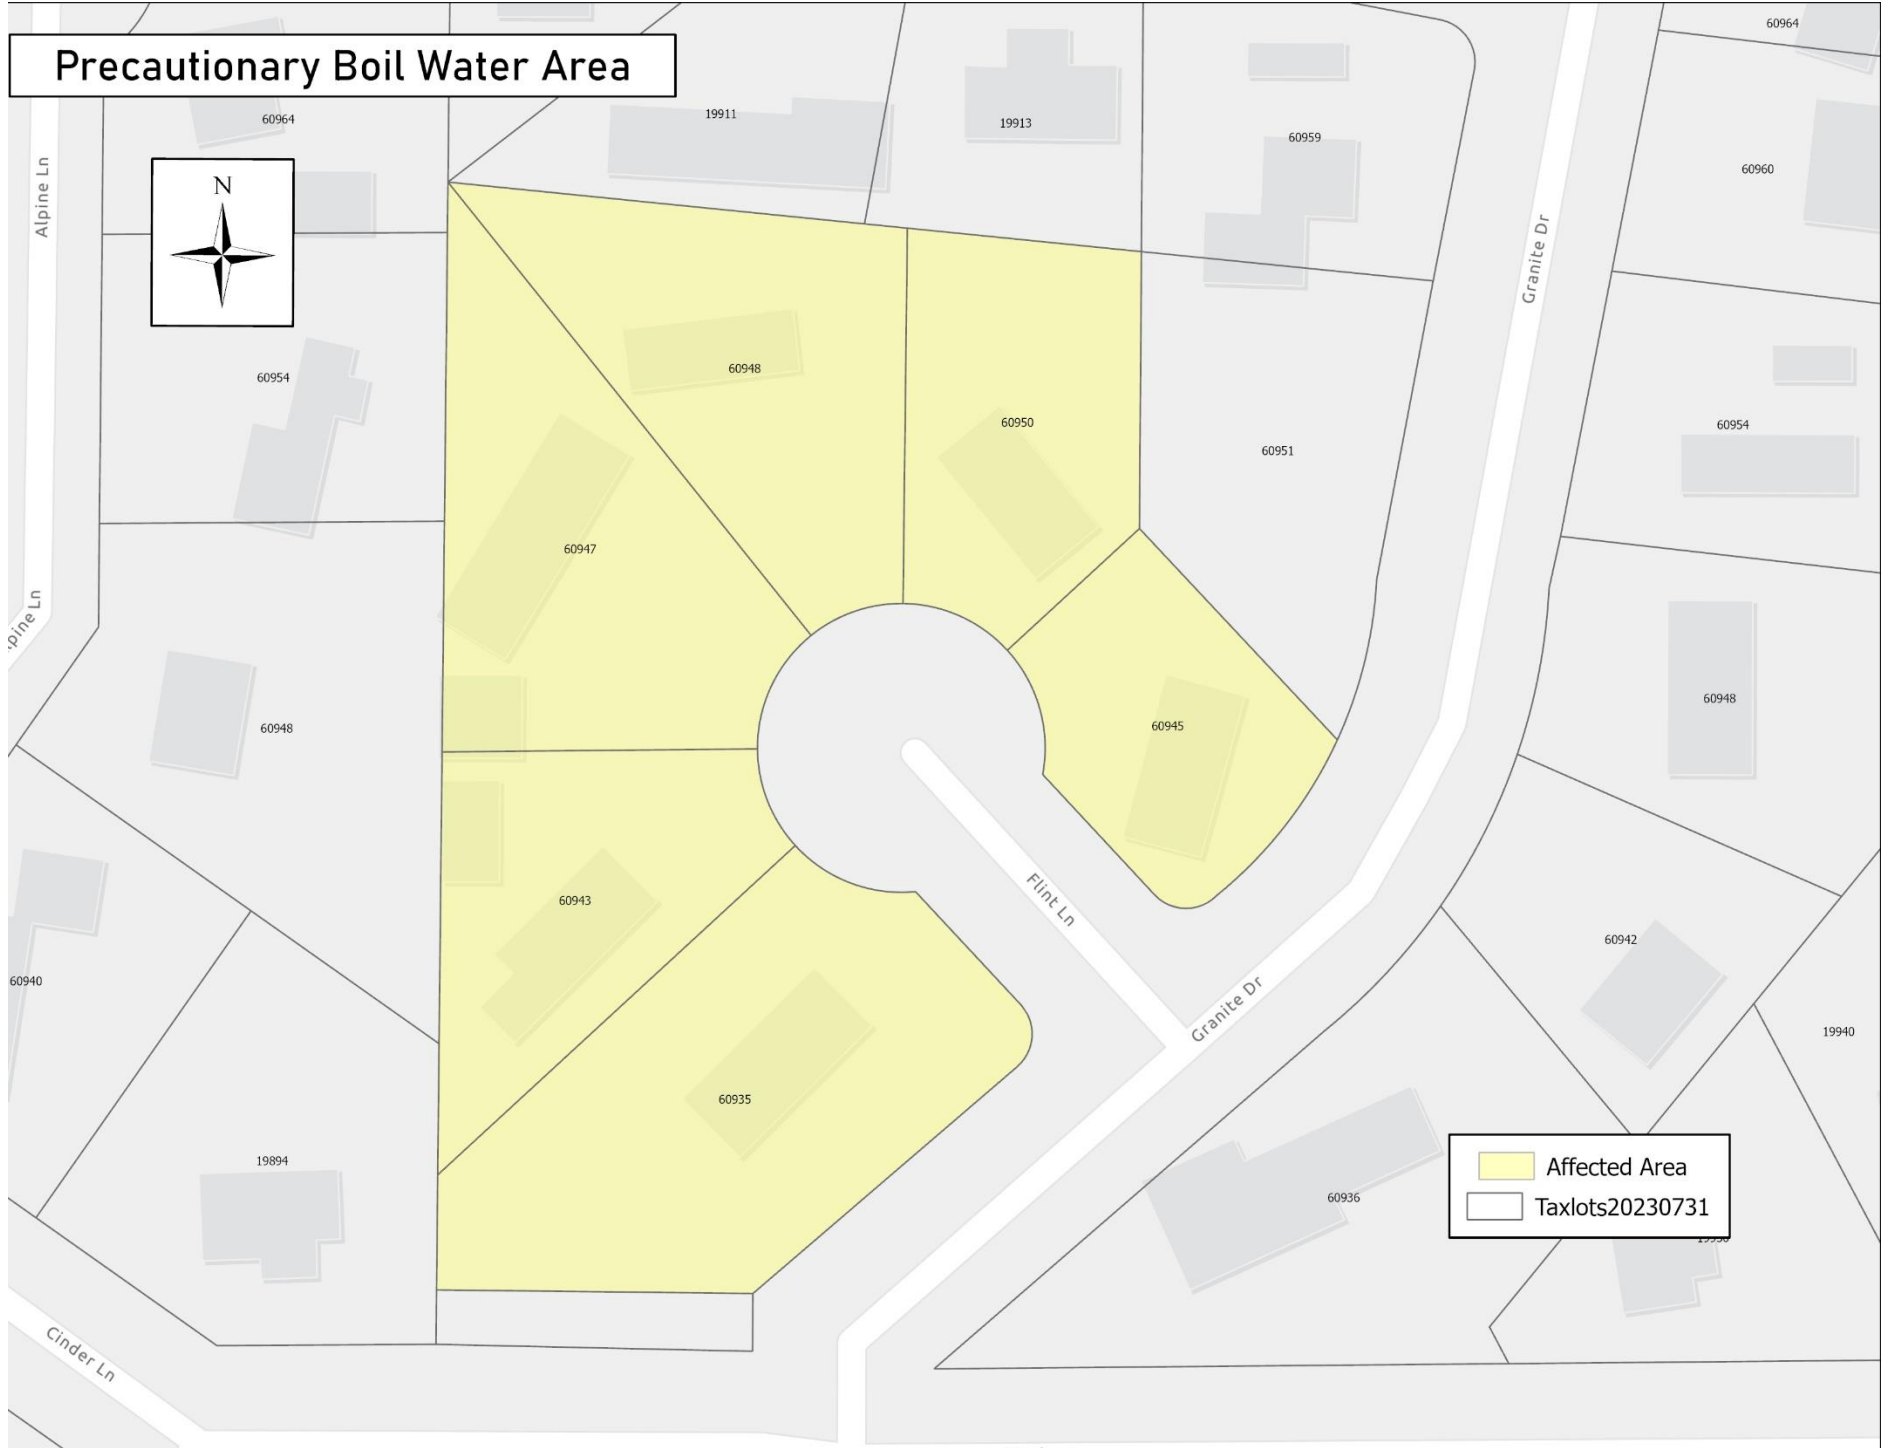

60943 FLINT LN



60945 GRANITE DR

60947 FLINT LN

60948 FLINT LN

Precautionary Boil Water Area



	Affected Area
	Taxlots20230731